


LAPP SYSTEMS USA

29 Hanover Road - Florham Park, NJ - 07932
800-774-3539 ◊ 973-660-9330

REVISIONS

ZONE	REV	DESCRIPTION	DATE	APPROVED
A		TEST ADDED	5/4/09	JC

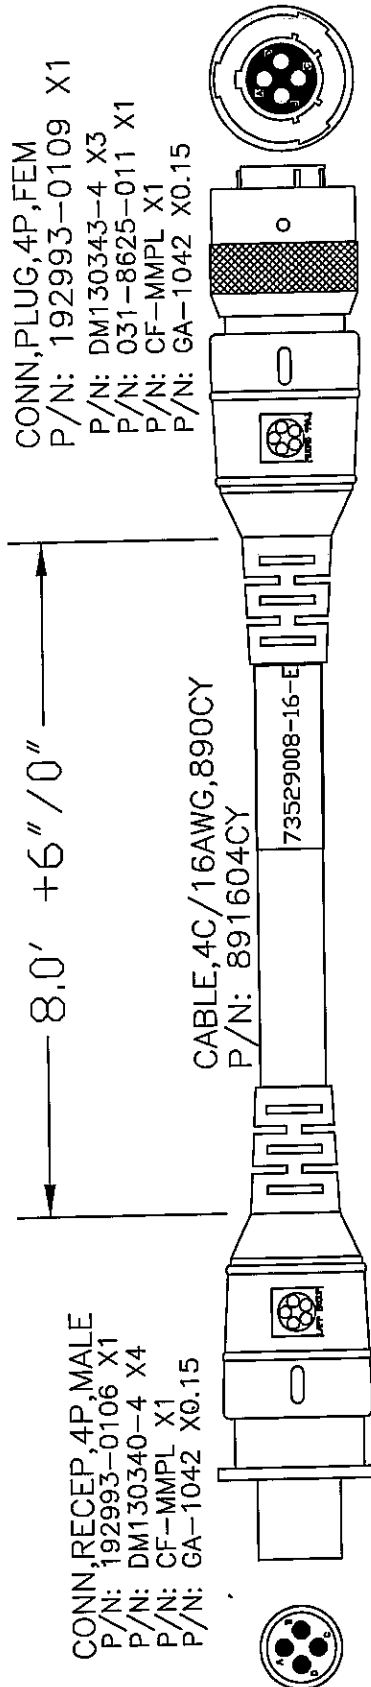

CONN, RECP, 4P, MALE
P/N: 192993-0106 X1
P/N: DM130340-4 X4
P/N: CF-MMPL X1
P/N: GA-1042 X0.15


8.0' + 6" / 10"

CABLE, 4C/16AWG, 890CY
P/N: 891604CY

73529008-16-E

CONN, PLUG, 4P, FEM
P/N: 192993-0109 X1
P/N: DM130343-4 X3
P/N: 031-8625-011 X1
P/N: CF-MMPL X1
P/N: GA-1042 X0.15

WIRING DIAGRAM

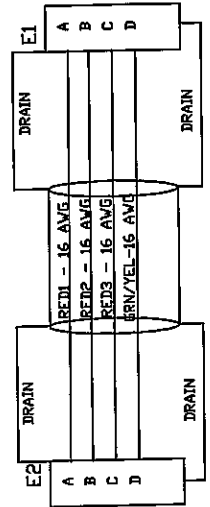

*CONNECTOR BACKSHELL SHIELDED
360

TEST PARAMETERS
>INSUL RES: 100M
>HI-POT: 1000V
>CONTACT RES: 0.05

- NOTES:
1. PINOUT AS PER PINOUT CHART.
 2. APPLY RING TO SHIELD/FITTING.
 3. APPLY O-RING TO CONN.
 4. STRIP JACKET AS REQUIRED FOR SHIELD.
 5. STRIP CONDUCTORS @ .250"
 6. APPLY TTSL-6 LABEL AND MARK PER REQUIREMENTS.

Dimensions are in inches unless otherwise specified.
Tolerances!

This document contains proprietary and confidential information and is the sole property of LAPP SYSTEMS USA, INC. Florham Park, NJ 07932. Reproduction of this document, in whole or in part, without the express written permission of LAPP SYSTEMS USA, INC is strictly prohibited.

CS1604PVCPC/8F-0		711844	
SIZE	FSCM NO.	DWG NO.	REV
A	N/A	73529008-16-E	A
SCALE		4/23/06	SHEET 1 OF 1

Customer Approval

Date

FNAME

REVDATE

USER