

HITACHI CABLE MANCHESTER

Customer Specification

HCM - 23149/16

RFQ #: 17072


ITEM DESCRIPTION: TAPE WRAP RND TO FLAT CABLE, CONSISTING OF 16 COND. FLAT PRIMARY, 28 AWG, BARRIER TAPED WITH A PVC JACKET. CM, C(UL)

FLAT PRIMARY:

CONDUCTOR: 28 AWG 7/36 TINNED COPPER
.015" NOM OD

INSULATION: PVC

THE #1 CONDUCTOR IS MARKED WITH A RED POLARITY STRIPE.

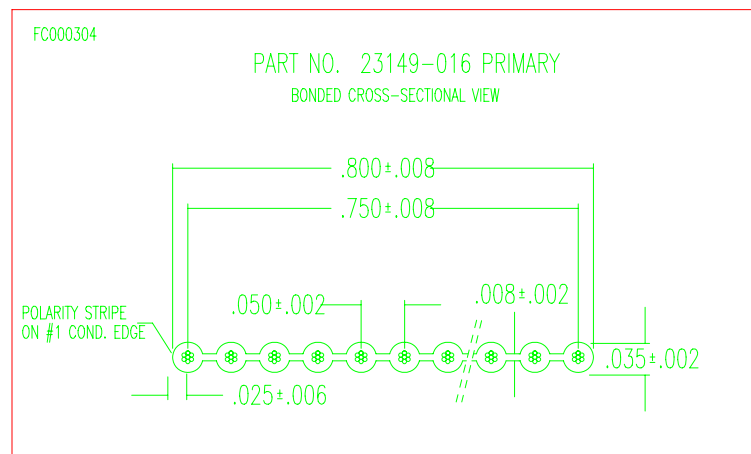


HITACHI CABLE MANCHESTER, INC. 900 Holt Avenue-East Industrial Park Manchester, N.H. 03109 (603) 669-4347	Drawn By: DSA Date: 07/07/98 Checked By: MGR Date: 07/08/98 Issued By: MGR Date: 07/08/98	REV# B
	THIS PRODUCT MADE IN THE U.S.A.	
ITEM: 23149-0016-XXX-XXX-000-S-00660-0805-00	PAGE 1 of 3 Approved By: Date:	

HITACHI CABLE MANCHESTER

Customer Specification

HCM - 23149/16

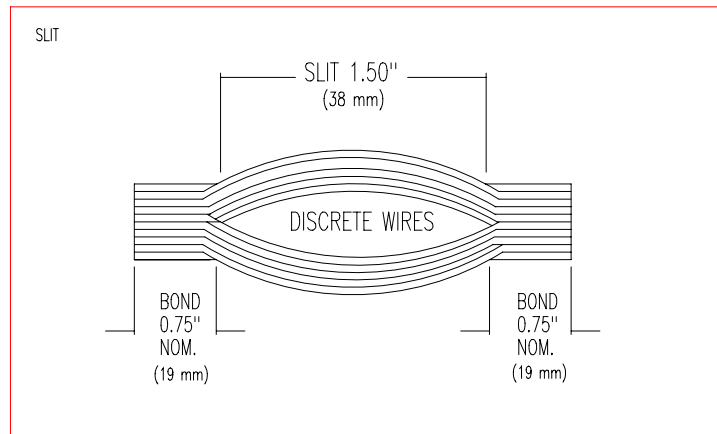

CABLING:

THE EXTRUDED FLAT PRIMARY IS CABLED INTO A ROUND CONFIGURATION WITH A RIGHT HAND LAY AND WRAPPED WITH A POLYESTER TAPE USING A LEFT HAND LAY, 25% MIN. OVERLAP ON TAPE.


OVERALL JACKET:

PVC BLACK
.268" NOM OD
.032" AVG WALL

HITACHI CABLE MANCHESTER

Customer Specification

HCM - 23149/16

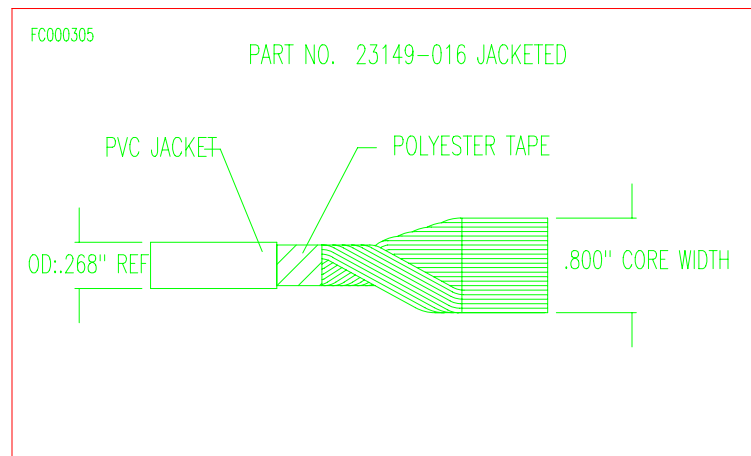

MARKING:

THE CABLE IS IDENTIFIED WITH THE FOLLOWING PRINT LEGEND:

HCM 23149 (UL) TYPE CM c(UL) 28 AWG 105C - Z/YY (XXXX)

WHERE: Z = MONTH OF MFG.

YY = YEAR OF MFG.

XXXX = JOB NUMBER

AGENCY APPROVALS:

UNDERWRITERS LABORATORIES, INC. TYPE CM CLASSIFIED COMMUNICATIONS CABLE FOR GENERAL PURPOSE COMMUNICATIONS USE WITH THE EXCEPTION OF RISERS & PLENUMS, IN ACCORDANCE WITH ARTICLE 800 OF THE NATIONAL ELECTRIC CODE.

Rev	Revision	Date	By	Appvd	PAGE 3 of 3
A	CHANGED PUT-UP QTY.	08/13/98	DSA	MG	
B	UPDATED HCM DESC.	12/09/98	HF	MG	