


## **Drawing / Data Sheet**

## GenFree® Uniblend® EPR/Copper Tape Shield/LZSH Jacket, 15kV(133%), UL Type MV-105

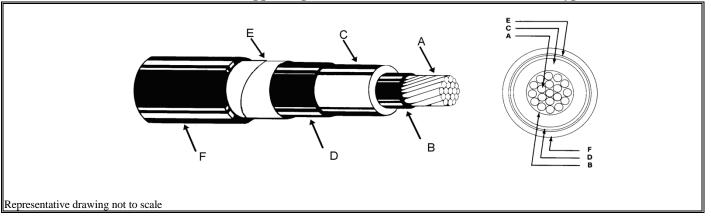

	Thickness (inches)		Diameter (inches)			
Component Description	Min.	Nom.*	Max.	Min.	Nom.*	Max.
A: Conductor				1.039	1.060	1.081
000 kcmil Class B Compact Strand CU Conductor				1.039	1.000	1.001
B: Conductor Shield	0.020	0.026			1.112	
Semiconducting Thermoset Polymer	0.020	0.020			1.112	
C: Insulation Insulation Level	0.210	0.220	0.250	1.520	1.552	1.610
Ethylene Propylene Rubber 133%	0.210	0.220	0.230	1.520	1.552	1.010
D: Insulation Shield	0.024	0.030	0.060	1.570	1.612	1.700
Semiconducting Thermoset Polymer	0.024	0.030	0.000	1.570	1.012	1.700
E: Metallic Shield		0.005			1.626	
1 x 1.5 " x 0.005 " Bare Copper Tape		0.005			1.020	
F: Jacket	0.100	0.110	0.150		1.946	
Overlaying Low-Smoke, Zero-Halogen Polyolefin (LSZH)	0.100	0.110	0.150		1.846	
Single Conductor Finished Cable Nominal Weight: 4219 lb/kft *						

\* - Nominal Values are Subject to Manufacturing Tolerances; Bold Font Indicates Minimum Average Values

Customer:	GENFREE® UNIBLEND®	Customer P/N:	Catalog Number:	
			17231.137500	
Specification /	AEIC CS8, ICEA S-97-682-2007/S-93-639, UL 1072 Type	Prepared By:	Date:	
Standard:	MV-105 "SUN RES FOR CT USE", IEEE 1202/FT4	HQQUJAH	3/25/2011	

This document was prepared for a specific purpose and the recipient, by accepting this information, assumes custody and control and agrees to take reasonable precautions that (a) this document will not be copied or reproduced, in whole or in part, or its contents revealed in any manner to any person, except to meet the specific purpose for which the document was delivered, and (b) that any features of this document will not be incorporated into any other projects without the express written permission of an officer of General Cable Corporation. This information has been calculated based on known formulae. The values are believed to be accurate and concise. Although they are mathematically derived, normal dimensional tolerances in actual cable construction and variations in the installation conditions may lead to differences between the indicated values and actual measured values.