




DESC: 18/3 SJT 105C 300V	DWG NO: FSJT183-254
SCALE: 20X	DATE: 2/24/12
DR. BY: DPL	NWI P/N: FSJT183-254
CUSTOMER: IEWC	CUSTOMER P/N: SJT1803-Z/105C

This document contains proprietary and confidential information of Northwire, Inc. (and its subsidiary) and shall not be used, disclosed or reproduced, in whole or in part, for any purpose without the prior written consent of Northwire, Inc. (and its subsidiary).

Disclaimer: The technical data that is made part of this document may be subject to the International Traffic in Arms Regulation (ITAR) and the Export Administration Regulations (EAR). Disclosure of technical data to Foreign Persons in the course of employment with U.S. contractors is considered an export and is subject to the ITAR and EAR export licensing requirements/regulations.

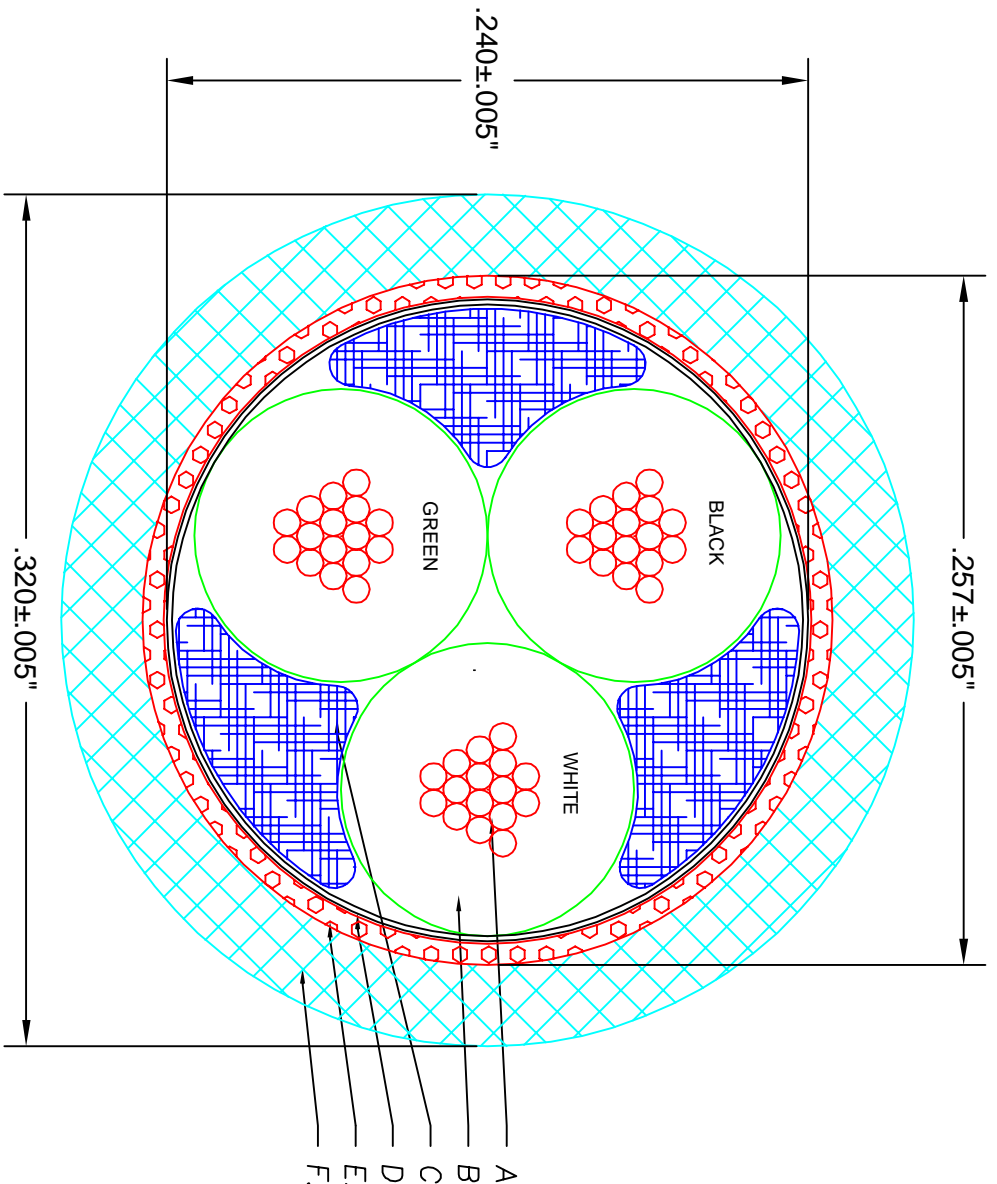

ITEM	SPECS.
A.	18 GAUGE 16x30BC BUNCHED
B.	30 MILS PVC INSULATION 105C 300V
C.	27 MILS MIN. PVC INSULATION O.D. .110±.002" STANDARD SJT CONDUCTOR POLY FILLER
D.	OPAQUE MYLAR WRAP
E.	20% MIN. OVERLAP 100% COVERAGE 85% MIN. TC BRAID SHIELD 38 AWG SINGLE ENDS
F.	30 MILS PRESSURED PVC JACKET 105C 300V 24 MILS MIN. PVC JACKET CLEAR JACKET UL AND CSA APPROVED

JACKET WILL MIGRATE SOME INTO THE BRAID JACKET REMOVAL WILL BE A LITTLE DIFFICULT DUE TO THIS

**ELECTRICAL REQUIREMENTS:**  
NONE SPECIFIED

**MECHANICAL REQUIREMENTS:**  
BRAID IS USED FOR DECORATIVE PURPOSES ONLY;  
ARCHITECTURAL LIGHTING APPLICATION

CORE DIMENSIONS FOR INTERNAL USE ONLY

- A.
- B.
- C.
- D.
- E.
- F.

LEGEND IN WHITE INK: (UL) E63042 3/C 18 AWG (.824mm<sup>2</sup>) SJT 105C 300V FT2 CSA LL30875

REMOVED VW-1	C	3/9/12	DPL
ADDED CUSTOMER PART NUMBER	B	2/27/12	DPL
INITIAL RELEASE	A	2/24/12	DPL
REVISION RECORD	REV	REV DATE	APR 1 APR 2 QA R



## RoHS Certification of Conformance

**Customer:** IEWC

**Northwire Part Number:** FSJT183-254

**Product Description:** Cbl 18/3 SJT 105C Clr 16x30B

We hereby certify that these products were manufactured to comply with the specifications as listed:

**RoHS compliant material is used for this product**

Justin Washburn **Northwire Quality Assurance** **Date:** 12/14/12