




| | | | |
|--------------------------|---------------|------------------------------|----------------------|
| DESC: 18/4 SJT 105C 300V | | DWG NO: 42208-1 R-A | |
| SCALE: 15x | DATE: 1/16/13 | DR. BY: DPL | NWI P/N: FSJT184-088 |
| CUSTOMER: IEWC | | CUSTOMER P/N: SJT1804-Z/105C | |

| ITEM | SPECS. |
|--|--|
| A. | 18 GAUGE 16x30BC BUNCHED |
| B. | 30 MIL PVC INSULATON 105C 300V 27 MIL MIN. PVC INSULATION O.D. .110±.002" |
| C. | POLY FILLER |
| D. | OPAQUE MYLAR WRAP 20% MIN. OVERLAP 100% COVERAGE |
| E. | 85% MIN. TC BRAID SHIELD 36 GAUGE SINGLE ENDS |
| F. | 30 MIL PRESSURED PVC JACKET 105C 300V 24 MIL MIN. PV JACKET CLEAR JACKET UL APPROVED AND CSA CERTIFIED |
| JACKET WILL MIGRATE INTO THE BRAID JACKET REMOVAL WILL BE A LITTLE DIFFICULT DUE TO THIS | |

This document contains proprietary and confidential information of Northwire, Inc. (and its subsidiary) and shall not be used, disclosed or reproduced, in whole or in part, for any purpose without the prior written consent of Northwire, Inc. (and its subsidiary).

Disclaimer: The technical data that is made part of this document may be subject to the International Traffic in Arms Regulation (ITAR) and the Export Administration Regulations (EAR). Disclosure of technical data to Foreign Persons in the course of employment with U.S. contractors is considered an export and is subject to the ITAR and EAR export licensing requirements/regulations.

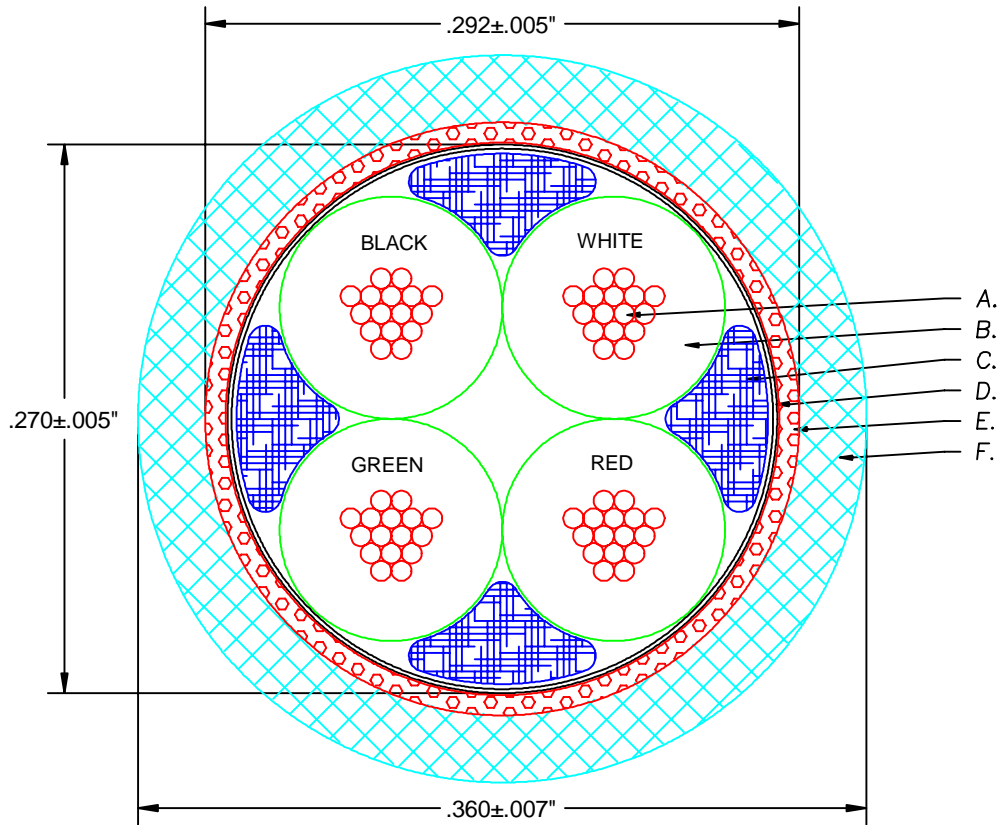

ELECTRICAL REQUIREMENTS:

NONE SPECIFIED

MECHANICAL REQUIREMENTS:

BRAID IS USED FOR DECORATIVE PURPOSES ONLY:
ARCHITECTURAL LIGHTING APPLICATON

CORE DIMENSIONS FOR INTERNAL USE ONLY

| | | | | | |
|-----------------|-----|----------|-------|-------|------|
| INITIAL RELEASE | A | 1/16/13 | DPL | | |
| REVISION RECORD | REV | REV DATE | APR 1 | APR 2 | QA R |