

RUG-04-2006(FRI) 15:35

AMERICAN COOLING TECHNOLOGY INC

(FAX)717 767 3658

P.001/001

08/04/2006 16:33

4408355971

I E W C

PAGE 02/02


ATTN: Steve Knievel

WORLDWIRE		DESC: 8/1 10/1 12/1 14/3 CABLE 105TC 300V	DWG NO: FCAB86C-001
SCALE: 8x	DATE: 08/03/06	DR: BY: MEN D	NVA P/N: FCAB86C-001
CUSTOMER: INDUSTRIAL ELECTRIC		CUSTOMER P/N: DR000000000-4	

ITEM	SPCS	DESCRIPTION
A.	8 GAUGE SOL CONDUCTOR SUPPLIED BY IENG 19X2785 43 MLS INSULATION .277 O.D.	
B.	10 GAUGE SOL CONDUCTOR SUPPLIED BY IENG 19X2386 41 MLS INSULATION .193 O.D.	
C.	14 GAUGE SOL CONDUCTOR SUPPLIED BY IENG 19X2785 35 MLS INSULATION .141 O.D.	
D.	12 GAUGE SOL CONDUCTOR SUPPLIED BY IENG 19X2586 37 MLS INSULATION .163 O.D.	
E.	POLY FILLER	
F.	CLEAR MILAR WRAP	
G.	70 MLS PRESSURED PVC JACKET 105TC 300V 50 MLS MIN. PVC JACKET YELLOW JACKET CABLE IS NOT UL OR CSA APPROVED	

REHS COMPART MATERIALS USED

A. B. C. D. E. F. G.

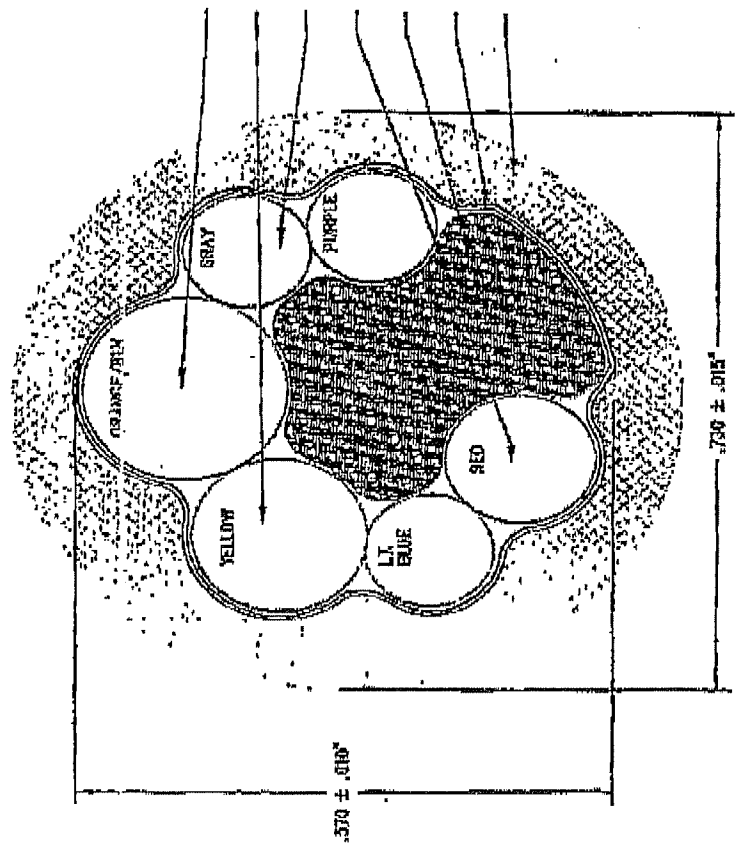

.570 ± .010"

.750 ± .015"

ELECTRICAL REQUIREMENTS:
NONE SPECIFIED

MECHANICAL REQUIREMENTS:
NONE SPECIFIED

SAP
8-4-06

REVISION RECORD	A	08/03/06	SKD
REVISION RECORD		REV/REV DATE	APPROVAL